
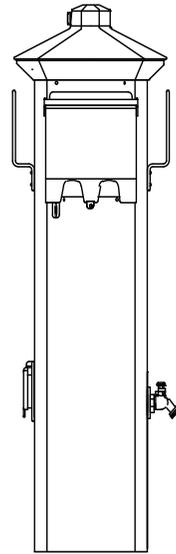


Lighthouse SS

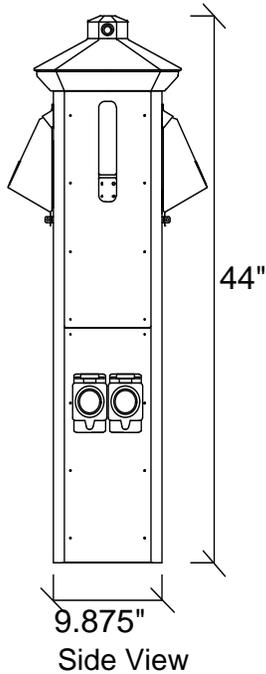


Metering
Unmetered
Bussing
Single Phase 3/8-16 stud Copper bus bar
Lighting
14 Watt
Lighting Protection
Breaker Protected
Lens Color
Amber

Side 1	Side 2	
Receptacles	Receptacles	Communications
(1) 50A, 125/250V	(2) 30A, 125V	2 CATV
Hardwired Breakers	Hardwired Breakers	Water
None	None	2 Valves
Extra Unmetered GFI		
None		

Special Modifications

<p>The information on this document is created by Eaton Corporation. It is disclosed in confidence and it is only to be used for the purpose in which it is supplied.</p>	PREPARED BY BettyNWheat	DATE 10/17/12	Eaton Corporation		
	APPROVED BY	DATE	JOB NAME 10-15-12 Menemsha Harbor		
	VERSION 7.9	DWG SIZE A	DESIGNATION 50/30-30	TYPE	DRAWING TYPE Customer Appr.
NEG-ALT NUMBER MPLT1015F204-0000	REVISION	DWG SIZE A	G.O.	ITEM	SHEET 1 OF 2

Lighthouse SS

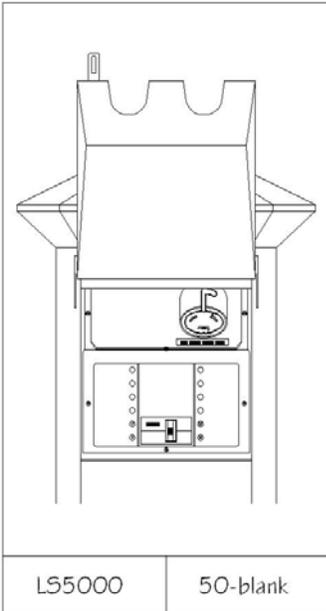

LS5000


50-blank

Side 1


Side 2

Bussing

Communications




PH	CATV	I/IT
0	1	0



PH	CATV	I/IT
0	1	0

Mounting Base & Dimensions

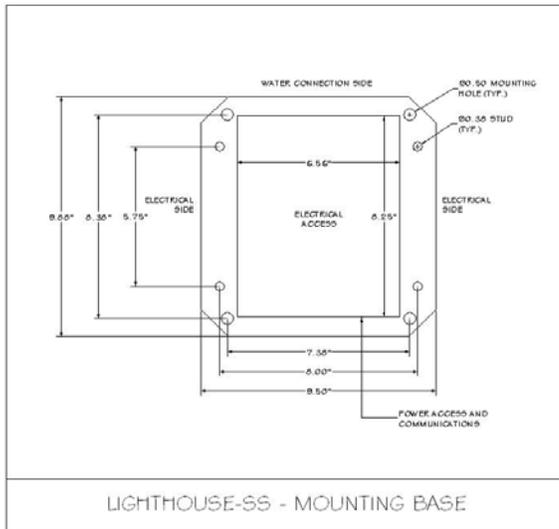

Water

The information on this document is created by Eaton Corporation. It is disclosed in confidence and it is only to be used for the purpose in which it is supplied.

PREPARED BY
BettyNWheat

DATE
10/17/12

Eaton Corporation

APPROVED BY

DATE

JOB NAME
10-15-12 Menemsha Harbor

DESIGNATION
50/30-30

VERSION

7.9

TYPE

DRAWING TYPE

Customer Appr.

NEG-ALT NUMBER
MPLT1015F204-0000

REVISION

DWG SIZE

A



G.O.

ITEM

SHEET

2 OF 2

Lighthouse

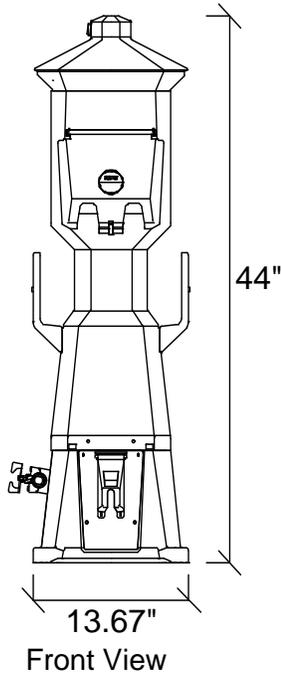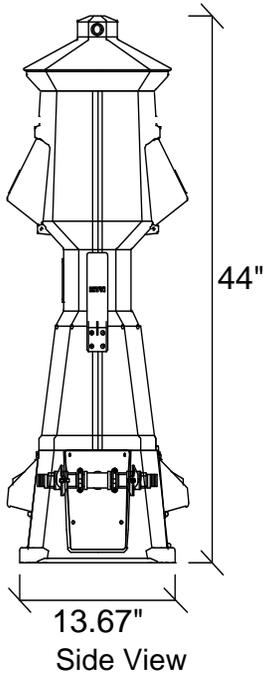



Metering
Unmetered
Bussing
Single Phase 3/8-16 stud Copper bus bar
Lighting
14 Watt
Lighting Protection
Breaker Protected
Lens Color
Amber

Side 1	Side 2	
Receptacles	Receptacles	Communications
(1) 50A, 125/250V	(2) 30A, 125V	2 CATV
Hardwired Breakers	Hardwired Breakers	Water
None	None	2 Valves
Extra Unmetered GFI		
None		

Special Modifications

<p>The information on this document is created by Eaton Corporation. It is disclosed in confidence and it is only to be used for the purpose in which it is supplied.</p>	PREPARED BY BettyNWheat	DATE 10/17/12	Eaton Corporation			
	APPROVED BY	DATE	JOB NAME 10-15-12 Menemsha Harbor			
	VERSION 7.9	DWG SIZE A	DESIGNATION 50/30-30	TYPE	DRAWING TYPE Customer Appr.	
NEG-ALT NUMBER MPLT1015F204-0000	REVISION	G.O.	ITEM	SHEET 1 OF 2		

Lighthouse SS

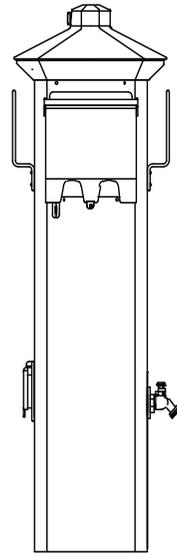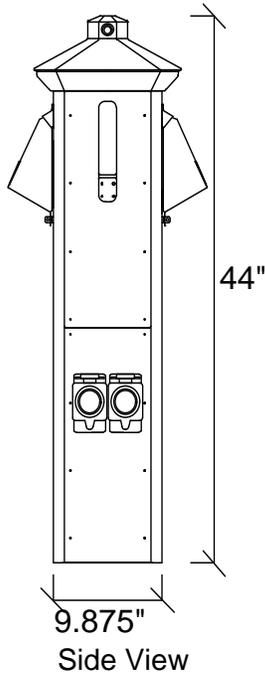


Metering
Unmetered
Bussing
Single Phase 3/8-16 stud Copper bus bar
Lighting
14 Watt
Lighting Protection
Breaker Protected
Lens Color
Amber

Side 1	Side 2	
Receptacles	Receptacles	Communications
(2) 50A, 125/250V	(2) 30A, 125V	2 CATV
Hardwired Breakers	Hardwired Breakers	Water
None	None	2 Valves
Extra Unmetered GFI		
None		

Special Modifications

<p>The information on this document is created by Eaton Corporation. It is disclosed in confidence and it is only to be used for the purpose in which it is supplied.</p>	PREPARED BY BettyNWheat	DATE 10/17/12	Eaton Corporation		
	APPROVED BY	DATE	JOB NAME 10-15-12 Menemsha Harbor		
	DESIGNATION 50-5030-30	TYPE	DRAWING TYPE Customer Appr.		
VERSION 7.9	REVISION	DWG SIZE A	G.O.	ITEM	SHEET 1 OF 2
NEG-ALT NUMBER MPLT1015F204-0000					

Lighthouse SS

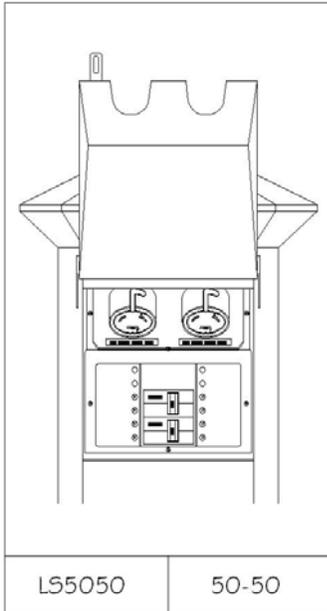

LS5050


50-50

Side 1


Side 2

Bussing

Communications




PH	CATV	I/IT
0	1	0



PH	CATV	I/IT
0	1	0

Mounting Base & Dimensions

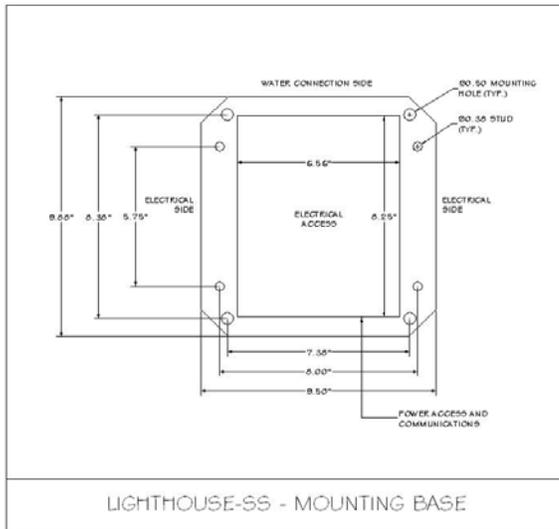

Water

The information on this document is created by Eaton Corporation. It is disclosed in confidence and it is only to be used for the purpose in which it is supplied.

PREPARED BY
BettyNWheat

DATE
10/17/12

Eaton Corporation

APPROVED BY

DATE

JOB NAME
10-15-12 Menemsha Harbor

DESIGNATION
50-5030-30

VERSION

7.9

TYPE

DRAWING TYPE

Customer Appr.

NEG-ALT NUMBER
MPLT1015F204-0000

REVISION

DWG SIZE

A



G.O.

ITEM

SHEET

2 OF 2

Lighthouse

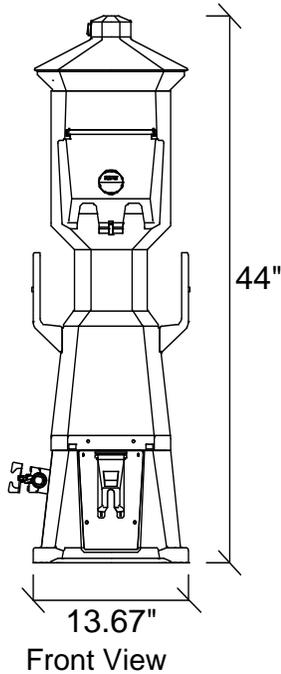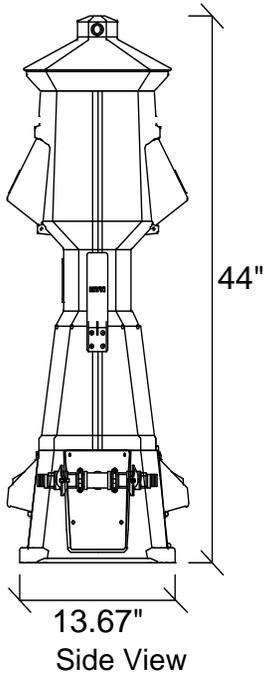


Metering
Unmetered
Bussing
Single Phase 3/8-16 stud Copper bus bar
Lighting
14 Watt
Lighting Protection
Breaker Protected
Lens Color
Amber

Side 1	Side 2	
Receptacles	Receptacles	Communications
(2) 50A, 125/250V	(2) 30A, 125V	2 CATV
Hardwired Breakers	Hardwired Breakers	Water
None	None	2 Valves
Extra Unmetered GFI		
None		

Special Modifications


<p>The information on this document is created by Eaton Corporation. It is disclosed in confidence and it is only to be used for the purpose in which it is supplied.</p>	PREPARED BY BettyNWheat	DATE 10/17/12	Eaton Corporation		
	APPROVED BY	DATE	JOB NAME 10-15-12 Menemsha Harbor		
	DESIGNATION 50-5030-30	TYPE	DRAWING TYPE Customer Appr.		
VERSION 7.9	REVISION	DWG SIZE A	G.O.	ITEM	SHEET 1 OF 2
NEG-ALT NUMBER MPLT1015F204-0000					

Lighthouse

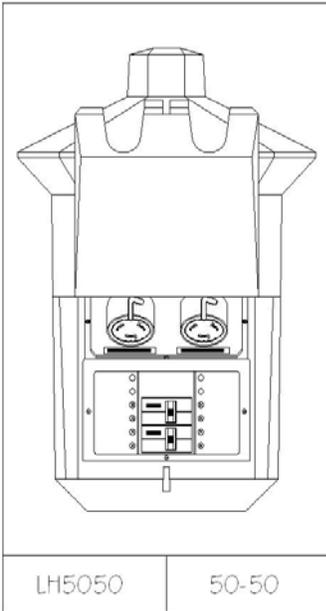

LH5050 50-50

Side 1

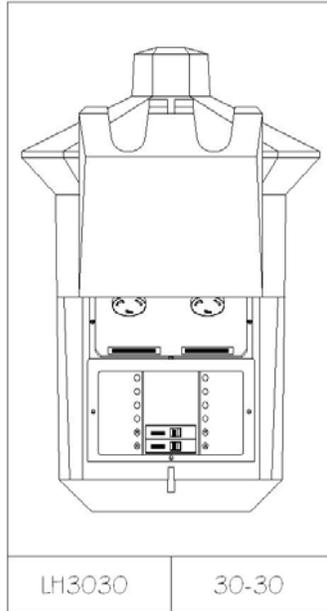


LH3030 30-30


Side 2

Bussing

Communications




PH	CATV	IIT
0	1	0




PH	CATV	IIT
0	1	0

Mounting Base & Dimensions

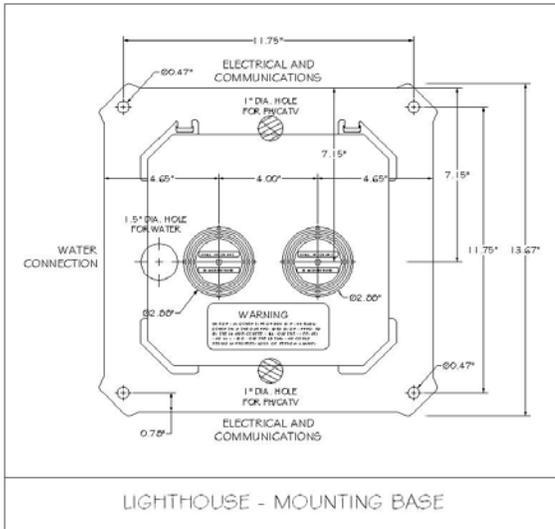

Water

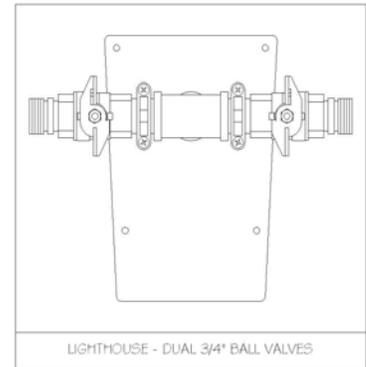

The information on this document is created by Eaton Corporation. It is disclosed in confidence and it is only to be used for the purpose in which it is supplied.

PREPARED BY
BettyNWheat

DATE
10/17/12

Eaton Corporation

APPROVED BY

DATE

JOB NAME
10-15-12 Menemsha Harbor

DESIGNATION
50-5030-30

VERSION

7.9

TYPE

DRAWING TYPE

Customer Appr.

NEG-ALT NUMBER
MPLT1015F204-0000

REVISION

DWG SIZE

A

G.O.

ITEM

SHEET

2 OF 2