
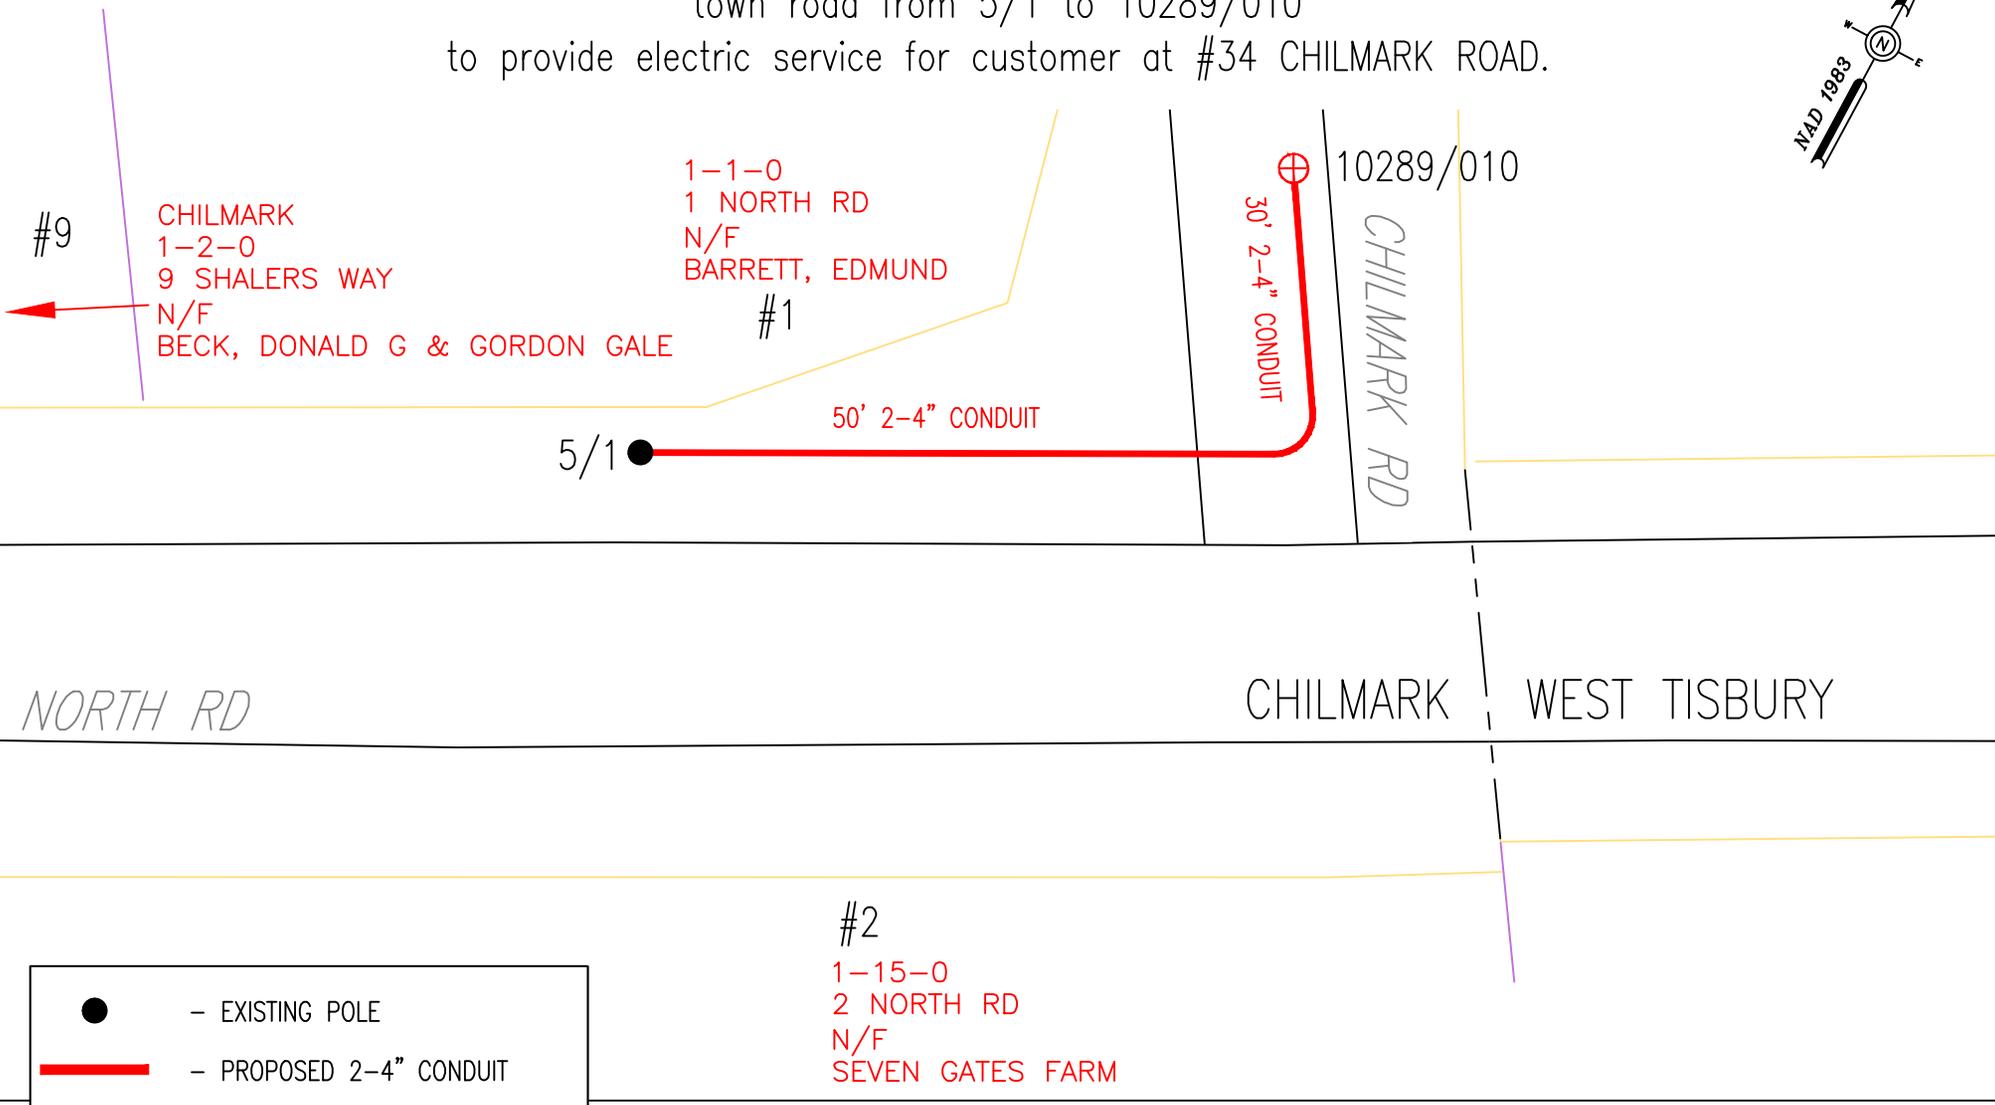


Plan to accompany petition of EVERSOURCE ENERGY
 To install approximately 80'± of underground cable & conduit under
 town road from 5/1 to 10289/010
 to provide electric service for customer at #34 CHILMARK ROAD.



- - EXISTING POLE
- PROPOSED 2-4" CONDUIT
- ⊕ - PROPOSED HANDHOLE

LOCATION	DATE	PLAN NO.	WORK ORDER NO.
#34 CHILMARK RD, CHILMARK	REV. 03/22/16	103887	2105243

EVERSOURCE ENERGY